

FILTRASORB® 816

Granular Activated Carbon

Applications



FILTRASORB 816 activated carbon can be used in a variety of liquid phase applications for the removal of dissolved organic compounds. FILTRASORB 816 has been successfully applied for over 40 years in applications such as drinking and process water purification, wastewater treatment, and food, pharmaceutical, and industrial purification.

Description

FILTRASORB 816 is a granular activated carbon developed by Calgon Carbon Corporation for the removal of dissolved organic compounds from water and wastewater as well as industrial and food processing streams. These contaminants include taste and odor compounds, organic color, total organic carbon (TOC), and industrial organic compounds such as TCE and PCE. This activated carbon is made from select grades of bituminous coal through a process known as reagglomeration to produce a high activity, durable, granular product capable of withstanding the abrasion associated with repeated backwashing, hydraulic transport, and reactivation for reuse. Activation is carefully controlled to produce a significant volume of both low and high energy pores for effective adsorption of a broad range of high and low molecular weight organic contaminants. FILTRASORB 816 is also formulated to comply with all the applicable provisions of the AWWA Standard for Granular Activated Carbon (B604), the stringent extractable metals requirements of ANSI/NSF Standard 61, and the Food Chemicals Codex.

Features / Benefits

- Calgon Carbon's reagglomerated coal-based granular activated carbons have several properties which provide superior performance in a wide range of applications
- Produced from a pulverized blend of high quality bituminous coals resulting in a consistent, high quality product
- The activated carbon granules are uniformly activated through the whole granule, not just the outside. This results in excellent adsorption properties and constant adsorption kinetics in a wide range of applications
- The reagglomerated structure ensures proper wetting while also eliminating floating material
- High mechanical strength relative to other raw materials, thereby reducing the generation of fines during backwashing and hydraulic transport
- Carbon bed segregation is retained after repeated backwashing, ensuring the adsorption profile remains unchanged and therefore maximizing the bed life
- Reagglomerated with a high abrasion resistance, which provides excellent reactivation performance
- High density carbon resulting in a greater adsorption capacity per unit volume

Specifications¹

FILTRASORB 816

Iodine Number, mg/g	900 (min)
Moisture by Weight	2% (max)
Effective Size	1.3–1.5 mm
Uniformity Coefficient	1.4 (max)
Abrasion Number	75 (min)
Screen Size by Weight, US Sieve Series	
On 8 mesh	15% (max)
Through 16 mesh	5% (max)

¹Calgon Carbon test method

Typical Properties*

FILTRASORB 816

Apparent Density (tamped)	0.50 g/cc
Water Extractables	<1%
Non-Wetttable	<1%

*For general information only, not to be used as purchase specifications.

Safety Message


Wet activated carbon can deplete oxygen from air in enclosed spaces. If use in an enclosed space is required, procedures for work in an oxygen deficient environment should be followed.

1.800.4CARBON calgoncarbon.com

© Copyright 2015 Calgon Carbon Corporation, All Rights Reserved
DS-FILTRA81616-EIN-E1


Typical Pressure Drop

Down Flow Pressure Drop at 13C/55°F
Based on a backwashed and segregated bed

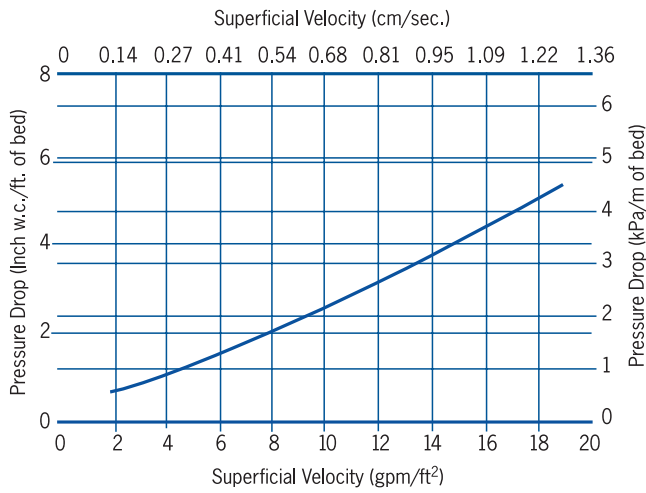

Typical Bed Expansion During Backwash

Bed Expansion During Backwash at 13C/55°F
Based on a backwashed and segregated bed

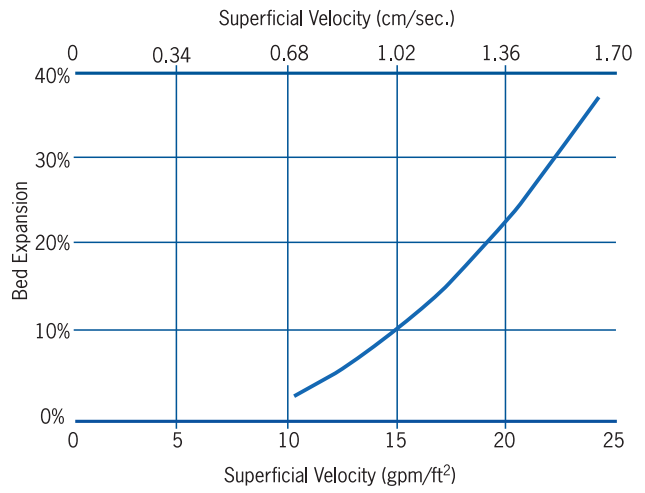

Design Considerations

FILTRASORB 816 activated carbon is typically applied in down-flow packed-bed operations using either pressure or gravity systems. Design considerations for a treatment system is based on the user's operating conditions, the treatment objectives desired, and the chemical nature of the compound(s) being adsorbed.

Safety Message

Wet activated carbon can deplete oxygen from air in enclosed spaces. If use in an enclosed space is required, procedures for work in an oxygen deficient environment should be followed.